

SPECIFICATION SHEET

• N3MGHP GLASS FRONT 3-DECK HIGH PERF. MED TEMP MERCHANDISERS • • N3MGHPE GLASS FRONT 3-DECK HIGH PERF. MED TEMP CROWN END MERCHANDISER •

Refrigeration Data:

					1	1				
			CAPACIT	Y (BTUH / FT)			DISCHARG	E AIR	AVG. REF.	
MODEL	CASE LENGTH	CASE USAGE	PARALLEL	CONVENTIONAL	EVAPORATOR (°F)	UNIT SIZING (°F)	TEMPERATURE (°F)	VELOCITY (FPM)	CHARGE (LBS/FT)	
N3MGHP	6'/8'/12'	MED TEMP	856*	939*	+25**	+23	+28.8	218***	0.48	
N3MGHPE	93"	MED TEMP	5,922/case	6,499/case	+25**	+23	+29	220***	0.42	

Capacity data listed for cases with 1 row of T-8 canopy lights and 3 rows of optional lighted shelves. Adjustments must be made to this base rating for each option installed on this case. DEDUCT 23 BTUH/FT for each row of unlighted shelves. For sizing all refrigeration equipment other than TYLER, use conventional BTUH values.

** Evaporator temperature is defined as the saturated suction temperature leaving the case.

FOR SPECIFIC COMPRESSOR SIZING INFORMATION, REFER TO TYLER APPLICATIONS FOR RACK SYSTEM COMPRESSORS AND/OR THE COMPRESSOR MANUFACTURERS FOR SINGLE COMPRESSORS. FOR LINE SIZING INFORMATION, REFER TO THE MISCELLANEOUS SECTION "BUFF" IN THE TYLER SPECIFICATION GUIDE.

Electrical Data:

Fans and Heaters (120 Volt)

	CASE	FANC /	TOTAL STANDARD FANS			OTAL 1 FANS	TOTAL ANTI-SWEATS				
MODEL	CASE LENGTH	FANS / CASE	AMPS	WATTS	AMPS	WATTS	DISCHA AMPS	ARGE AIR WATTS	FRONT GLASS AMPS WATTS		
N3MGHP	6'	2	1.06	96.0	0.44	22.0	0.10	12.0	0.07	8.4	
N3MGHP	8'	2	1.06	96.0	0.44	22.0	0.13	15.6	0.09	10.8	
N3MGHP	12'	3	1.59	144.0	0.66	33.0	0.20	24.0	0.14	16.8	
N3MGHPE	93"	2	2.00	165.2			0.97	116.4	N/A	N/A	

T-8 Lighting with Electronic Ballasts (120 Volt)

		CANOPY	LIGHTS*		Ç	MAXIMUM LIGHTING (4 ROWS)					
MODEL	CASE LENGTH	AMPS	WATTS	AMPS 1 2 3			WATTS 1 2 3			AMPS	WATTS
N3MGHP	6'	0.40	48	0.50	0.80	1.10	60	96	132	1.50	180
N3MGHP	8'	0.50	60	0.70	1.10	1.40	84	132	168	1.90	228
N3MGHP	12'	0.70	84	1.05	1.65	2.10	126	198	252	2.80	336
N3MGHPE	93"	1.06	127	1.06	2.12	3.18	127	255	382	4.24	509

^{*} Standard lighting for this case is 1 row of canopy lights.

Defrost Data:

2011-001-20121												
	DEEDOCTO	DURATION		THERMOST NSOR SETT			PR NGS ***	CONV	ENTIONAL SETTIN	. COMPRE IGS****	ESSOR	DEFROST
DEFROST TYPE*	DEFROSTS PER DAY	TIME (MIN)**	USAGE	CUT IN	CUT OUT	R22 (PSIG)	R404A (PSIG)	R22 (CUT-IN	(PSIG) CUT-OUT	R404A CUT-IN	(PSIG) CUT-OUT	WATER (LB / FT / DAY)
TIME OFF – N3MGHP	4	32	MED TEMP	29°F	27°F	49	62	47	36	60	47	5.1
TIME OFF - N3MGHPE	4	32	MED TEMP	29°F	27°F	49	62	47	36	60	47	5.2

^{*} All high performance cases use **OFF CYCLE** defrost.

^{****} Required setup for a conventional unit uses an electronic thermostat to assure accurate temperature control.

CASE-TO-CASE SUCTION LINE SUB-FEED BRANCH LINE SIZING												
MODEL 6' 8' 12' 16' 20' 24' 28' 32' 36'						36′	40′	44′	48′			
N3MGHP / R22	1/2"	1/2"	5/8"	7/8"	7/8"	7/8"	7/8"	7/8"	7/8"	1 1/8"	1 1/8"	1 1/8"

CASE CIRCUITS: This case requires a 120V circuit for fans, lights and anti-sweat heaters.

Screens are standard. Shelving must be ordered separately. All rows of shelving require a shelf gasket. Shelves are available in 12", 15", 16", 18" and 20" deep sizes. When multiple shelf sizes are used, position smallest shelf size on top to largest shelf size on bottom.

UL SANITATION approved in accordance with ANSI/NSF - 7.

CASE BTUH REQUIREMENTS are calculated to produce approximately the indicated entering-air temperature with absolute maximum operating ambient limits of 75°F & 55RH.

The information contained herein is based on technical analysis and/or tests performed in a controlled lab environment that are consistent with industry practices, and is intended as a reference for system sizing and configuration purposes only and for use by persons having technical skill at their own discretion and risk. Conditions of use are outside of Tyler's control and we do not assume and hereby disclaim any liability for results obtained or damages incurred through application of or reliance on the data presented, including but not limited to specific energy consumption with any particular model or installed application. SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.


^{***} Air velocity measured 1 hour after defrost at the top discharge air duct using an ALNOR JR. velometer with a scoop.

^{**} NOTE: 32 minutes is for EPR with suction stop for defrost isolation. Defrost times increases by six minutes (38 min. total) when defrost isolation is by pump down.


^{***} If EPR is utilized, use the settings shown in the chart. **NOTE:** The customer will need to set the EPR on the parallel rack or single unit to the appropriate suction temperature and the N3MGHP cases must be on a separate suction stub with a separate EPR. **ADD** 0.5# to EPR setting for each 1000 foot rise in elevation.



N3MGHP CROSS SECTION

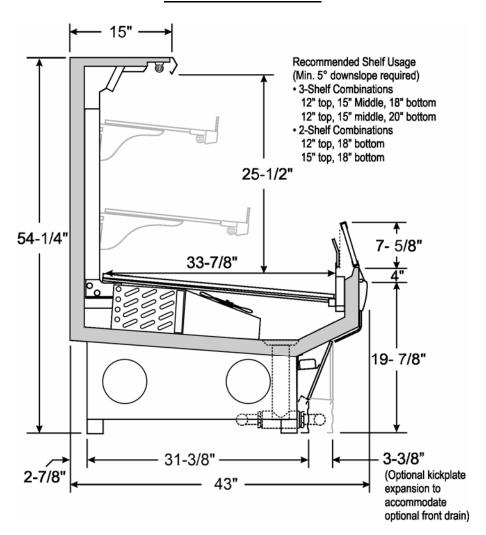


FLOOR PLAN

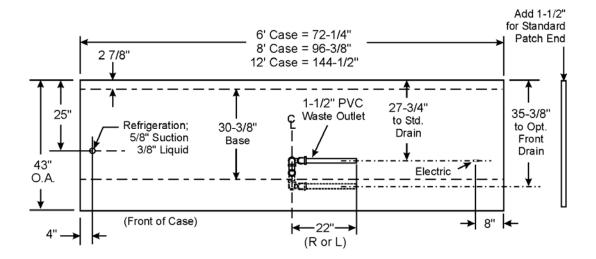



N3MGHPE FLOOR PLAN

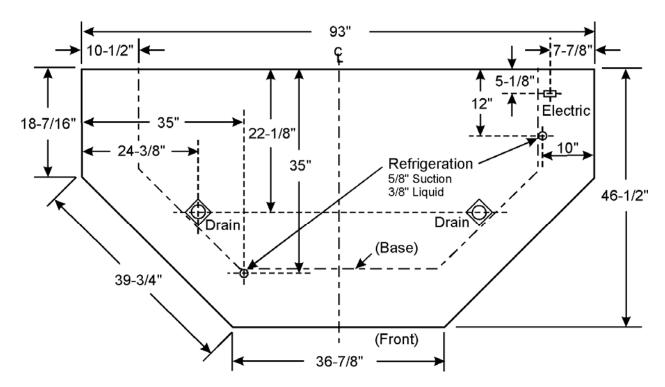

NOTE: There are four separate Suction & Liquid Refrigeration Line connection points in this case. All Refrigeration Lines can connect to either side of the adjoining case-to-case lineup. The access holes in the back of the N3MGHPE case line up with the access holes in the ends of the N3MGHP case.